

NDC Polipak Ltd

1 Garratts Lane
Old Hill
Cradley Heath
West Midlands B64 5RE
Tel: 0121 561 6700 Fax: 0121 559 0230
e-mail: sales@ndcpolipak.co.uk
website: www.ndcpolipak.com



Agrément Certificate
09/4692
Product Sheet 1

NDC POLIPAK MEMBRANES

DAMPLAS DAMP-PROOF MEMBRANES

This Agrément Certificate Product Sheet⁽¹⁾ relates to Dampplas Damp-proof Membranes, for use in solid concrete ground floors that are not subject to hydrostatic pressure, to protect buildings against moisture from the ground.

(1) Hereinafter referred to as 'Certificate'.

CERTIFICATION INCLUDES:

- factors relating to compliance with Building Regulations where applicable
- factors relating to additional non-regulatory information where applicable
- independently verified technical specification
- assessment criteria and technical investigations
- design considerations
- installation guidance
- regular surveillance of production
- formal three-yearly review.



KEY FACTORS ASSESSED

Resistance to water and water vapour — the membranes provide an effective barrier to the passage of liquid water and water vapour from the ground (see section 6).

Resistance to puncturing — the membranes have a high resistance to puncture and on a smooth or blinded surface will not be damaged by foot or site traffic, eg wheelbarrows (see section 7).

Durability — under normal service conditions the membranes will provide an effective barrier to water and water vapour for the life of the concrete slab in which they are installed (see section 10).

The BBA has awarded this Certificate to the company named above for the products described herein. These products have been assessed by the BBA as being fit for their intended use provided they are installed, used and maintained as set out in this Certificate.

On behalf of the British Board of Agrément

A handwritten signature in black ink, appearing to read 'Simon Wroe'.

Date of Second issue: 19 February 2014

Originally certificated on 23 September 2009

Simon Wroe
Head of Approvals — Materials

A handwritten signature in black ink, appearing to read 'Claire Curtis-Thomas'.

Claire Curtis-Thomas
Chief Executive

The BBA is a UKAS accredited certification body — Number 113. The schedule of the current scope of accreditation for product certification is available in pdf format via the UKAS link on the BBA website at www.bbacerts.co.uk

Readers are advised to check the validity and latest issue number of this Agrément Certificate by either referring to the BBA website or contacting the BBA direct.

British Board of Agrément
Bucknalls Lane
Watford
Herts WD25 9BA

tel: 01923 665300
fax: 01923 665301
e-mail: mail@bba.star.co.uk
website: www.bbacerts.co.uk

©2014

Regulations

In the opinion of the BBA, Damplas Damp-proof Membranes, if installed, used and maintained in accordance with this Certificate, will satisfy or contribute to satisfying the relevant requirements of the following Building Regulations (the presence of a UK map indicates that the subject is related to the Building Regulations in the region or regions of the UK depicted):



The Building Regulations 2010 (England and Wales) (as amended)

Requirement:	C2(a)	Resistance to moisture
Comment:		The products will meet this Requirement. See section 6 of this Certificate.
Regulation:	7	Materials and workmanship
Comment:		The products are acceptable. See section 10.1 and the <i>Installation</i> part of this Certificate.



The Building (Scotland) Regulations 2004 (as amended)

Regulation:	8(1)	Fitness of materials and workmanship
Comment:		The products comply with this Standard. See section 10.1 and the <i>Installation</i> part of this Certificate.
Regulation:	9	Building standards applicable to construction
Standard:	3.4	Moisture from the ground
Comment:		The products will enable a floor to satisfy the requirements of this Standard, with reference to clauses 3.4.1 ⁽¹⁾⁽²⁾ , 3.4.2 ⁽¹⁾⁽²⁾ , 3.4.4 ⁽¹⁾⁽²⁾ and 3.4.6 ⁽¹⁾⁽²⁾ . See section 6 of this Certificate.
Standard:	7.1(a)	Statement of sustainability
Comment:		The products can contribute to meeting the relevant requirements of Regulation 9, Standards 1 to 6 and therefore will contribute to a construction meeting a bronze level of sustainability as defined in this Standard.
Regulation:	12	Building standards applicable to conversions
Comment:		All comments given for these products under Regulation 9, Standards 1 to 6 also apply to this Regulation, with reference to clause 0.12.1 ⁽¹⁾⁽²⁾ and Schedule 6 ⁽¹⁾⁽²⁾ . (1) Technical Handbook (Domestic). (2) Technical Handbook (Non-Domestic).



The Building Regulations (Northern Ireland) 2012

Regulation	23(a)(i)(iii)(b)(i)	Fitness of materials and workmanship
Comment:		The products are acceptable. See section 10.1 and the <i>Installation</i> part of this Certificate.
Regulation:	28(a)	Resistance to moisture and weather
Comment:		The products will enable a floor to satisfy this Regulation. See section 6 of this Certificate.

Construction (Design and Management) Regulations 2007

Construction (Design and Management) Regulations (Northern Ireland) 2007

Information in this Certificate may assist the client, CDM co-ordinator, designer and contractors to address their obligations under these Regulations.

See section: 1 *Description* (1.2) of this Certificate.

Additional Information

NHBC Standards 2014

NHBC accepts the use of Damplas Damp-proof Membranes, provided they are installed, used and maintained in accordance with this Certificate, in relation to *NHBC Standards*, Chapter 5.1 *Substructure and ground bearing floors*, Clause M8 *Damp-proof membrane*.

CE marking

The Certificate holder has taken the responsibility of CE marking the products in accordance with harmonised European Standard BS EN 13967 : 2012. An asterisk (*) appearing in this Certificate indicates that data shown are given in the manufacturer's Declaration of Performance.

Technical Specification

1 Description

1.1 Damplas Damp-proof Membranes are blown films of extruded polyethylene.

1.2 The nominal characteristics are shown in Table 1.

Table 1 Nominal characteristics of Damplas Damp-proof Membranes

Characteristic (unit)	Grade		
	Dampplas 250	Dampplas 300	Dampplas 500
Thickness* (µm)	250	300	500
Width* (m)	4	4	4
Roll length* (m)	15, 25	15, 25	12.5
Roll weight (kg)	23	27.6	23
Tensile strength* (N·50 mm ⁻¹)			
transverse	>365	>365	>365
longitudinal	>228	>228	>228
Watertightness* (2kPa)	Pass	Pass	Pass
Colour	Blue, black ⁽¹⁾	Blue, black ⁽¹⁾	Blue, black ⁽¹⁾

(1) Other colours are available.

2 Manufacture

2.1 The membranes are manufactured from a blown film of extruded polyethylene.

2.2 As part of the assessment and ongoing surveillance of product quality, the BBA has:

- agreed with the manufacturer the quality control procedures and product testing to be undertaken
- assessed and agreed the quality control operated over batches of incoming materials
- monitored the production process and verified that it is in accordance with the documented process
- evaluated the process for management of nonconformities
- checked that equipment has been properly tested and calibrated
- undertaken to carry out the above measures on a regular basis through a surveillance process, to verify that the specifications and quality control operated by the manufacturer are being maintained.

2.3 The management system of NDC Polipak Ltd has been assessed and registered as meeting the requirements of BS EN ISO 9001 : 2008 by Lloyd's Register Quality Assurance Ltd (Certificate LRQ 4001509).

3 Delivery and site handling

3.1 Damplas Damp-proof Membranes are wound onto one metre wide cardboard tubes and packaged in individual polyethylene sleeves bearing labels with the product's name and the BBA logo incorporating the number of this Certificate. Rolls are then shrink-wrapped on to pallets.

3.2 Rolls should be stored under cover on the original pallet or individually, on end and on a flat, level surface, and protected from direct heat and sunlight. The polyethylene wrapper should not be removed until immediately before installation.

Assessment and Technical Investigations

The following is a summary of the assessment and technical investigations carried out on Damplas Damp-proof Membranes.

Design Considerations

4 Use

4.1 Damplas Damp-proof Membranes are satisfactory for use in concrete floors not subject to hydrostatic pressure, in accordance with the relevant clauses of CP 102 : 1973.

4.2 The membranes can be installed either as an oversite membrane, between a blinded hardcore bed and the base concrete, or as a sandwich membrane in base concrete or between the base concrete and the screed.

5 Practicability of installation

The products are designed to be installed by a competent installer, or a contractor, experienced with these types of products.

6 Resistance to water and water vapour



6.1 The membranes, including joints, provide an effective barrier to the passage of liquid moisture from the ground.

6.2 When installed in accordance with the following documents, the 300 µm and 500 µm membranes comply with the minimum sheet thickness detailed in the national Building Regulations:

England and Wales — Approved Document C, Requirement C2(a), Section 3, clauses 4.8 and 4.9

Scotland — Mandatory Standard 3.4, clauses 3.4.1, 3.4.2, 3.4.4 and 3.4.6

Northern Ireland — Regulation 28(a) Technical Booklet C, Sections 1 and 2.

The 250 µm membrane additionally complies with the minimum sheet thickness detailed in the national Building Regulations for Scotland.

7 Resistance to puncturing

On smooth or blinded surfaces the membranes will accept, without damage, the limited foot traffic and loads associated with installation. The membranes can be punctured by sharp objects and care should be taken to avoid damage during installation, particularly when handling building materials and equipment over the surface and when placing concrete or screeds.

8 Underfloor heating

The membranes will not be adversely affected when used in conjunction with underfloor heating under normal operating conditions. However, the advice of the Certificate holder should be sought.

9 Maintenance

As the membranes are confined within the concrete ground floors and have suitable durability (see section 10), maintenance is not required. Any damage occurring during installation must be repaired prior to overlaying with concrete (see section 14).

10 Durability



10.1 When subject to normal use, the membranes will provide an effective barrier to liquid water and water vapour or moisture for the life of the concrete slab in which they are installed.

10.2 Long periods of exposure to ultraviolet light will reduce the effectiveness of the membranes. They should be protected from such exposure during storage and when in use.

11 Reuse and recyclability

The product comprises polyethylene, which can be recycled.

Installation

12 General

12.1 Installation of Damplas Damp-proof Membranes should be in accordance with the Certificate holder's instructions, clause 11 of CP 102 : 1973, the relevant clauses of BS 8000-4 : 1989 and section 13 of this Certificate.

12.2 Unless the base is smooth, a surface blinding of soft sand (or similar material) should be used to prevent puncturing during installation or when the concrete or screed is being placed.

12.3 The membranes must be clean and free from dirt and grease.

12.4 The products can be installed in all conditions normal to ground floor slab construction. Where there is a risk of ground becoming waterlogged, sub-soil drainage must be provided in accordance with CP 102 : 1973.

12.5 The type of floor finish to be used may limit the suitability of a polythene dpm. The guidance given in CP 102 : 1973 should be followed.


13 Procedure

13.1 A double welted fold should be formed using at least 300 mm of the membrane. It is essential that the fold is held in position prior to placing the concrete, eg by weighting with bricks (see Figure 1).

13.2 The damp-proof membranes must be continuous with the damp-proof course in the surrounding walls. Where necessary the membranes should be used as a vertical damp-proof course to link the two.

13.3 The membranes must be covered by a screed or other protective layer as soon as possible after installation. Care should be taken to ensure that they are not stretched or displaced when placing the concrete or screed over them. Sufficient allowance should be made to avoid bridging (ie creating areas of unsupported membrane) during screeding operations at details such as internal angles.

Figure 1 Double welted fold joint

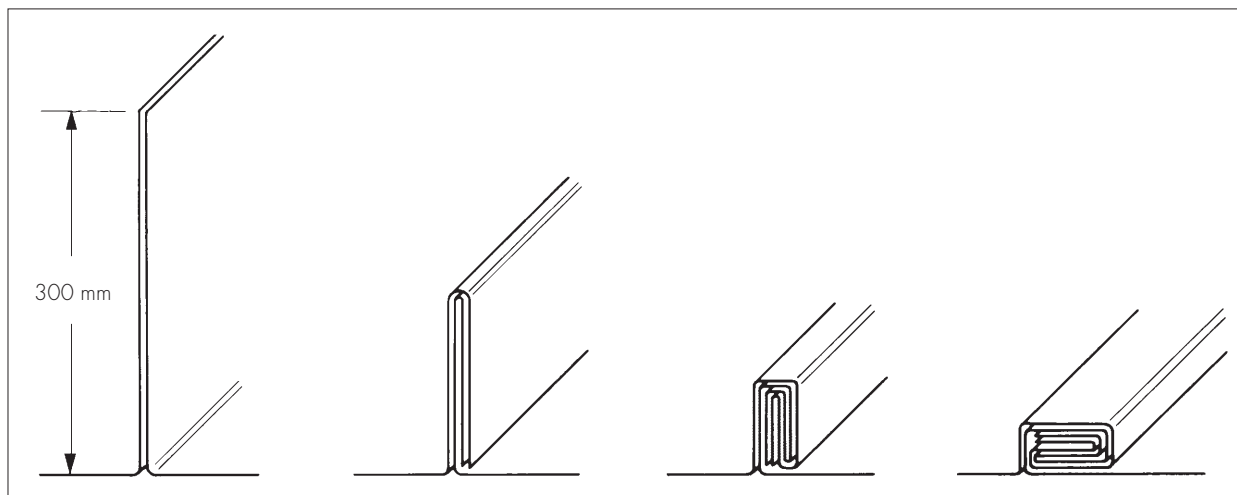

14 Repair

Perforations or punctures in the membrane should be patched with sheets of identical thickness, lapped at least 150 mm beyond the limits of the puncture, and the laps so formed sealed with double-sided pressure sensitive tape.

Technical Investigations

15 Tests

Tests were carried out on Damplas Damp-proof Membranes and the results assessed to determine:

- thickness
- density
- water vapour transmission rate
- water vapour resistance
- dart impact
- low temperature flexibility
- tensile strength
- elongation at break
- dimensional stability
- resistance to nail and trouser tear
- effect of heat and UV ageing on tensiles and elongation
- effect of heat ageing on nail tear and trouser tear.

16 Investigations

The manufacturing process was evaluated, including methods adopted for quality control, and details were obtained of the quality and composition of the materials used.

Bibliography

BS 8000-4 : 1989 *Workmanship on building sites — Code of practice for waterproofing*

BS EN BS EN 13967 : 2012 *Flexible sheets for waterproofing – Plastic rubber damp-proof sheets including plastic and rubber basement tanking sheet – Definition and Characteristics*

BS EN ISO 9001 : 2008 *Quality management systems — Requirements*

CP 102 : 1973 *Code of practice for protection of buildings against water from the ground*

17 Conditions

17.1 This Certificate:

- relates only to the product/system that is named and described on the front page
- is issued only to the company, firm, organisation or person named on the front page — no other company, firm, organisation or person may hold or claim that this Certificate has been issued to them
- is valid only within the UK
- has to be read, considered and used as a whole document — it may be misleading and will be incomplete to be selective
- is copyright of the BBA
- is subject to English Law.

17.2 Publications, documents, specifications, legislation, regulations, standards and the like referenced in this Certificate are those that were current and/or deemed relevant by the BBA at the date of issue or reissue of this Certificate.

17.3 This Certificate will remain valid for an unlimited period provided that the product/system and its manufacture and/or fabrication, including all related and relevant parts and processes thereof:

- are maintained at or above the levels which have been assessed and found to be satisfactory by the BBA
- continue to be checked as and when deemed appropriate by the BBA under arrangements that it will determine
- are reviewed by the BBA as and when it considers appropriate.

17.4 The BBA has used due skill, care and diligence in preparing this Certificate, but no warranty is provided.

17.5 In issuing this Certificate, the BBA is not responsible and is excluded from any liability to any company, firm, organisation or person, for any matters arising directly or indirectly from:

- the presence or absence of any patent, intellectual property or similar rights subsisting in the product/system or any other product/system
- the right of the Certificate holder to manufacture, supply, install, maintain or market the product/system
- actual installations of the product/system, including their nature, design, methods, performance, workmanship and maintenance
- any works and constructions in which the product/system is installed, including their nature, design, methods, performance, workmanship and maintenance
- any loss or damage, including personal injury, howsoever caused by the product/system, including its manufacture, supply, installation, use, maintenance and removal
- any claims by the manufacturer relating to CE marking.

17.6 Any information relating to the manufacture, supply, installation, use, maintenance and removal of this product/system which is contained or referred to in this Certificate is the minimum required to be met when the product/system is manufactured, supplied, installed, used, maintained and removed. It does not purport in any way to restate the requirements of the Health and Safety at Work etc. Act 1974, or of any other statutory, common law or other duty which may exist at the date of issue or reissue of this Certificate; nor is conformity with such information to be taken as satisfying the requirements of the 1974 Act or of any statutory, common law or other duty of care.